

FIG. 1

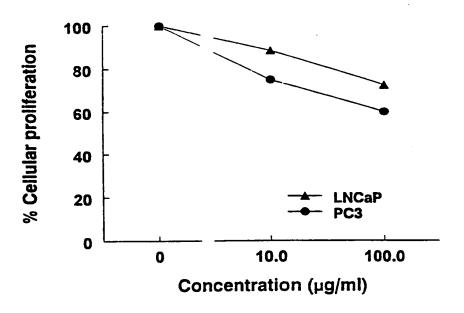



FIG. 2





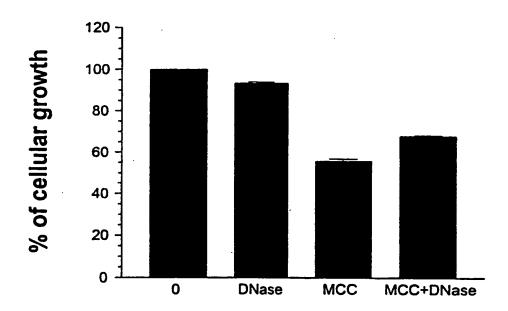


FIG. 3


BEST AVAILABLE COPY

FIG. 4


4/6


Control PC-3 untreated

PC-3 + MCC 200 µg/ml

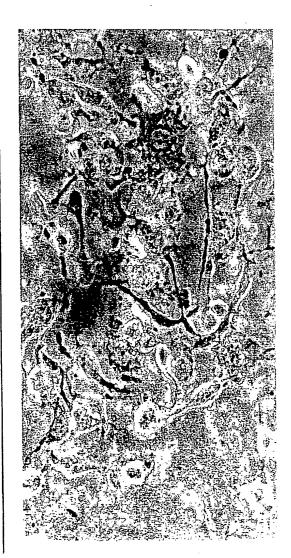

SUBSTITUTE SHEET (RULE 26)



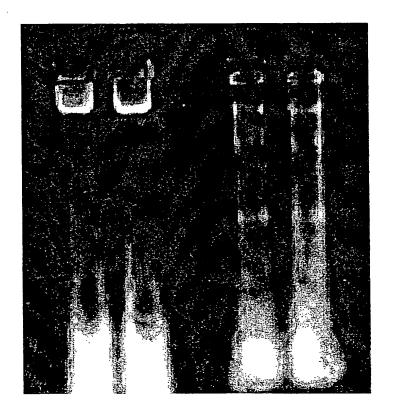

6/6

